

## TFB-3165X

Renkli Alarm Butonları, Tekrar Kurulabilir

### Montaj ve Kullanma Kılavuzu

#### ÖNEMLİ UYARILAR

##### GENEL

- Cihazları çalıştırmadan önce bu kılavuzu dikkatlice okuyunuz ve daha sonra da faydalanmak için saklayınız.
- Kullanma kılavuzunda belirtilen tüm uyarı ve önlemlere uyunuz. Tüm işletme ve kullanma talimatlarına sırası ile uyunuz.
- Cihazları su ve nemden uzak tutunuz.

##### ORTAM ŞARTLARI

Cihazı aşağıdaki koşullar dışında aşırı sıcak ve soğuk ortamlarda çalıştırmayınız.

Sıcaklık: -10°C ile +60°C arası

Nem: +40°C'de ≤93%

##### SERVİS

Cihazı kendi başınıza tamir etmeye kalkmayınız, cihazın kapağını açmanız durumunda elektrik şokuna maruz kalabilirsiniz.

Herhangi bir arıza durumunda satıcınız veya yetkili servisinizle irtibat kurunuz. Cihaza teknik müdahale mutlaka kalifiye yetkili servis personeli tarafından yapılmalıdır.

##### SERVİS GEREKTİREN ARIZA DURUMLARI

Herhangi bir arıza durumunda veya aşağıdaki durumlarda yetkili servisinizle veya satıcınızla irtibat kurunuz.

- Güç kablosu zarar gördüğünde,
- Cihazın içine herhangi bir sıvı aktığında veya nesne düştüğünde,
- Suya veya yağmura maruz kaldığında,
- Cihaz düşürüldüyse ya da muhafaza zarar gördüyse □ Cihazda fark edilebilecek seviyede performans değişikliği varsa,
- Cihaz, kullanma kılavuzunda belirtilen işletme talimatlarına göre normal çalışmıyorsa

##### KENDİ BAŞINIZA YAPABİLECEKLERİNİZ

Cihazı kendi başınıza tamir etmeye kalkmayınız, zira cihazın kapağını açmanız durumunda elektrik şokuna maruz kalabilirsiniz. Herhangi bir arıza durumunda satıcınız veya yetkili servisinizle irtibat kurunuz. Cihaza teknik müdahale mutlaka kalifiye yetkili servis personeli tarafından yapılmalıdır. Cihaz kuru bir bezle temizlenmelidir. Herhangi bir kimyasal madde kullanılmamalıdır.

##### TAŞIMA VE NAKLİYE


Cihaz dışarıdan herhangi bir darbeye maruz kalmayacak ve sıvı girişine mahal vermeyecek şekilde dikkatle taşınmalıdır. Uygunsuz taşıma sırasında oluşan arızalar garanti kapsamı dışındadır.

##### İNSAN VE ÇEVRE SAĞLIĞI

Bu cihaz insan sağlığına zarar verecek herhangi bir kimyasal veya biyolojik madde içermez.


#### MONTAJ VE BAĞLANTI


1. İlgili kabloyu buton tabanının içinden geçecek şekilde duvara montaj ediniz. Duvara montaj vidalarını çok fazla sıkmayınız.



2. Butunun içinde C ile R uçları arasında dahili 470 ohm direnç vardır. Bağlantı için ilaveten 470 ohm bağlamanıza gerek yoktur. 470 ohm Alarm direnci isteyen paneller için kabloları C ve R uçlarına direkt bağlayınız.

Butonu, NO ya da NC kullanmanız gerekirse, 2 telli kablunun bir ucu C diğer ucu ise kullanmak istediğiniz NO ya da NC ucuna bağlayabilirsiniz.

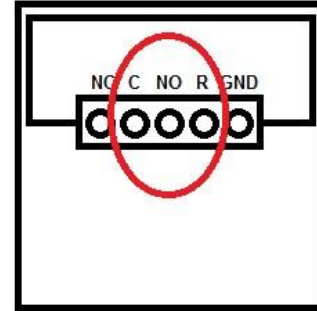

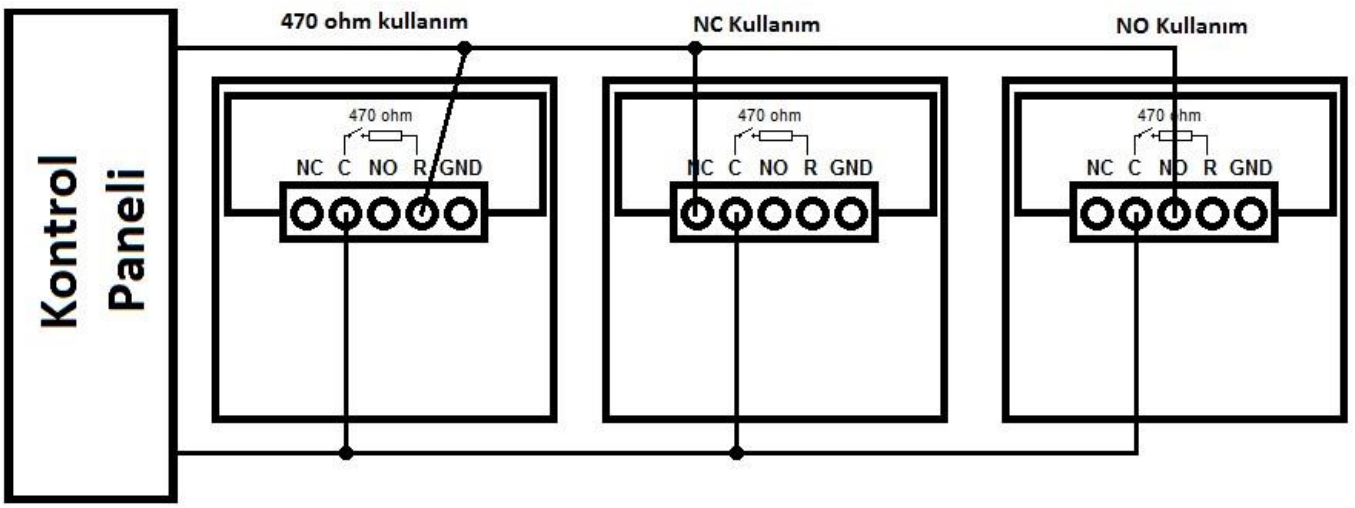

haline geldiği gözlemlenir.

13/6/2014 tarihli ve 29029 sayılı Resmî Gazete'de yayımlanan Satış Sonrası Hizmetler Yönetmeliği eki listede tespit ve ilan edilen kullanım ömrü 5 yıldır.

Tüketici, garantiden doğan hakların kullanılması ile ilgili olarak çıkabilecek uyuşmazlıklarda yerleşim yerinin bulunduğu veya tüketici işleminin yapıldığı yerdeki Tüketici Hakem Heyetine veya Tüketici Mahkemesine başvurabilir.




### ÖZELLİKLER

Model	Nominal Çalışma Gerilimi	Besleme Gerilimi	Alarm Akımı	Uygun Kablo Kalınlığı	Uygun çalışma sıcaklığı(°C), Nem	Kırılabilir Unsurun Türü, Kullanım Alanı	Gövde Malzemesi, Boyutlar, Ağırlık,
TFB-3165X	24 VDC	5-32 VDC	0 ( LED Yok)	0,4mm ~ 2.0mm Arası	-10 ~ +60 ≤93% @ +40°C	A , Kapalı Alan Sıva Üstü Kullanım	ABS 86x55x88mm 164,5 gr

### ÜRETİCİ FİRMA VE MERKEZ SERVİS

\* AEEE yönetmeliğine uygundur. Bu ürün, geri dönüşümlü ve tekrar kullanılabilir nitelikteki yüksek kaliteli parça ve malzemelerden üretilmiştir. Bu nedenle, ürünü, hizmet ömrünün sonunda evsel veya diğer atıklarla birlikte atmayın. Elektrikli ve elektronik cihazların geri dönüşümü için bir toplama noktasına götürün.

### TEST

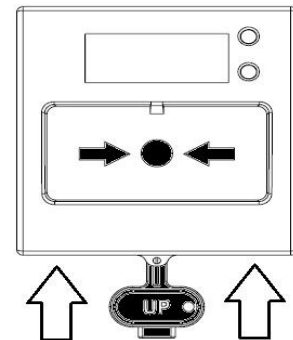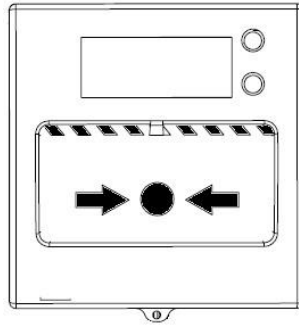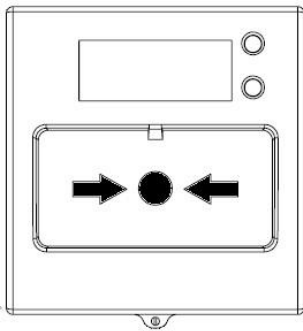

1 ) İlk durumda iken Kırbasın Panelinde Alarm ortasına basılır. gözlemlenir.

2 ) Yangın durumu

3 ) Kutunun içinden çıkan anahtar takılarak Yukarı doğru itilir ve ilk

## IMPORTANT WARNINGS

### GENERAL

- Before using the device read this manual carefully. Keep it just in case of necessity.
- Abide all the rules and precautions stated in the manual. Follow all the instructions one by one.
- Keep the devices away from water and moisture.

### CONDITIONS

Do not energize the device above or below the given limits of extreme hot or cold conditions.

Temperature: -10°C ile +60°C arası

Relative Moisture: +40°C'de ≤93%

### SERVICE

Do not try to fix the device on your own. Removal of cover may end up with electricity shock.

In case of any defect or malfunction, contact with your dealer or with authorized service. All the technical interventions have to be done by technicians of company.

### MALFUNCTIONS THAT REQUIRE TECHNICAL SERVICE

In case of any malfunction or below conditions contact with your authorized service,

- When Mains cable or the plug is harmed,
- Contact of device with a fluid,
- Exposure of rain and water,
- Fell down of device or harmed outer cover,
- Serious performance fall on the device, □ Depending on the instructions stated in manual, if your device not working properly, further usage or possible wrong usage may cause other malfunctions. Contact with your authorized service in such terms.

### MAINTENANCE ON YOUR OWN

Do not try to fix the device on your own. Removal of cover may end up with electricity shock.

In case of any defect or malfunction, contact with your dealer or with authorized service. All the technical interventions have to be done by technicians of company. Device must be cleaned up with a dry fabric. No-chemicals are allowed for cleaning

### TRANSPORTATION

Device must be carefully transported avoiding all physical bump, stroke and possible fluid entry. Malfunctions that caused by improper transportation is not under warranty.

## HUMAN AND NATURE CONDITION

This device contains no chemical or biological elements that could harm human condition

## Models


**TFB-3165W** EMERGENCY BUTTON, WHITE

**TFB-3165G** EMERGENCY DOOR RELEASE BUTTON, GREEN

**TFB-3165O** SMOKE VENT BUTTON, ORANGE



## MOUNTING AND CONNECTION

1. Mount the wall of the manual call base so that the fire cords pass through the rear hole. Do not tighten the wall mounting screws too much.




2. There is an internal 470-ohm resistor between the C and R connectors in the manual call point. You do not need to connect an additional 470 ohms for the connection. Connect the + (plus) cable from the Conventional Fire Alarm panel to the R connector, and the - (minus) cable to the C connector.

If you need to use NO or NC on another system, you can connect a 2-wire cable to terminal C and the other to the NO or NC terminal you want to use.

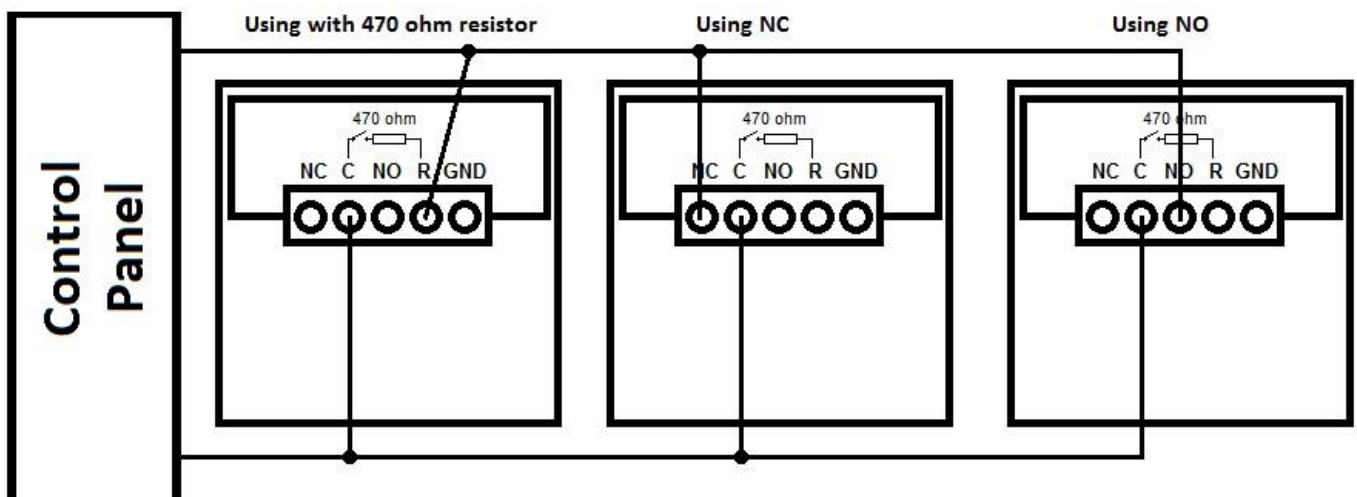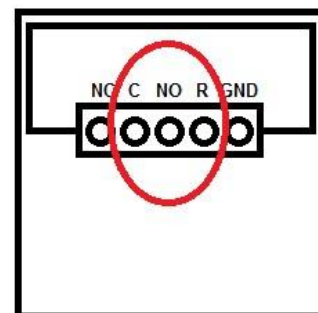


## TEST

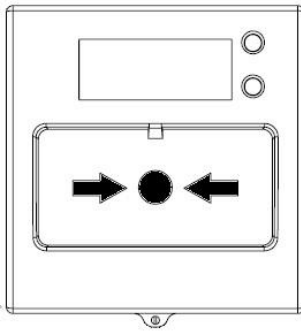


1 ) In the first case press in the middle point of Manual call

point.

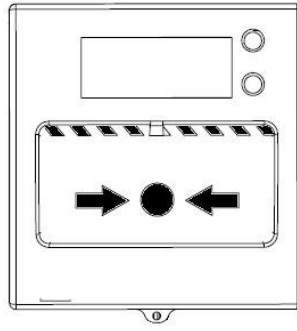

2 ) Alarm condition observed on the Manual Call Point.

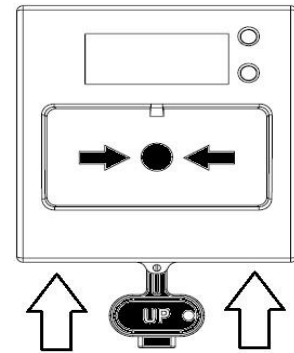

3 ) The key from inside the box is inserted and is pushed upwards and observed to be the first condition.

## SPECIFICATION

Model	Nominal Operating Voltage	Operating Voltage	Alarm Current	Suitable Cable Thickness	Suitable Operating Temperature (°C), Moisture	Type of Breakable Feature, Usage Area	Body Material, Dimensions, Weight
TFB-3165X	24 VDC	5-32 VDC	0 ( No LED )	Between 0,4mm to 2.0mm	-10 ~ +60 ≤93% @ +40°C	A, Closed area Surface Mount	ABS 86x55x88mm 164,5 gr

## MANUFACTURER

2012/19/EU (WEEE directive): Products marked with this symbol cannot be disposed of as unsorted municipal waste in the European Union. For proper recycling, return this product to your local supplier upon the purchase of equivalent new equipment, or dispose of it at designated collection points. For more information see: [www.recyclethis.info](http://www.recyclethis.info).